NOTE: PIPE PROJECTIONS ARE SHOWN FOR REFERENCE ONLY
CUSTOMER TO SUPPLY PIPING

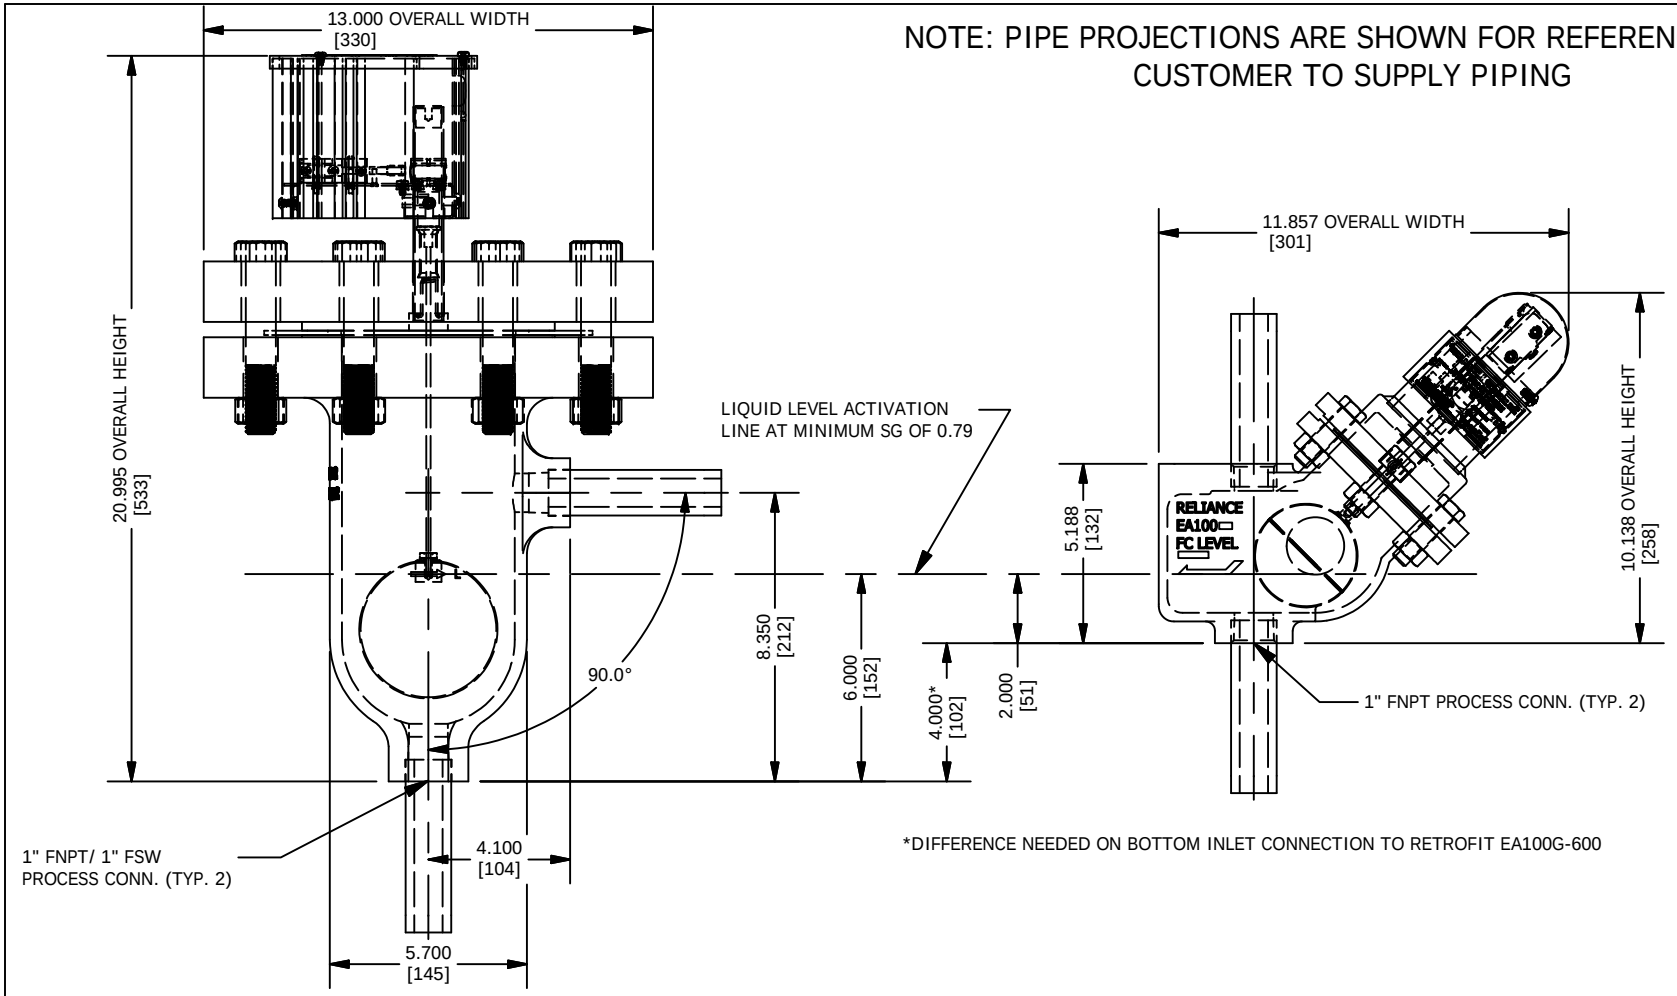

*DIFFERENCE NEEDED ON BOTTOM INLET CONNECTION TO RETROFIT EA100G-600

MODEL NUMBER EA100G-600

NOTES:
1. MICRO SWITCH APPROVED FOR THE FOLLOWING RATINGS:
   5A-125, 250, OR 480 VAC
   1/2A - 125 VDC
   1/4A - 250 VDC
2. UNITS IN INCHES W/ MM EQUIVALENTS IN BRACKETS
3. MINIMUM SG. =.799
4. MAWP PER B16.5 GROUP 1.1 600 CLASS FLANGE
5. DESIGN PRESSURE: 1000 PSI MAWP
6. HYDROTEST PRESSURE: 1500 PSI

MODEL NUMBER EA100S

NOTES:
1. MICRO SWITCH, TYPE BZ-2RW82444-A2
   UL APPROVED FOR THE FOLLOWING RATINGS:
   5A-125, 250, OR 480 VAC
   .50A-125 VDC
   .25A-250 VDC
2. UNITS IN INCHES W/ MM
   EQUIVALENTS IN BRACKETS
3. STATIONARY SERVICE RATING:
   MAX PRESSURE: 800 PSI @ 520°F
4. HYDROTEST: 1200 PSI

ALL DIMENSIONS IN INCHES [MM]

REV	DATE	REVISION	BY
1	5/28/2019	ADJUSTED ACTIVATION LEVEL FROM 7.51" TO 6.00"	NK

MANUFACTURED BY
Clark·Reliance®
16633 FOLTZ PARKWAY
STRONGSVILLE, OH 44149 USA
(440) 572-1500 | www.clarkreliance.com
© Clark-Reliance® Corporation. All Rights Reserved.

RELIANCE®

EA100G-600 VS EA100S PIPING CHANGE DIAGRAM

PART NUMBER:	REA1356 & REA100S
TOLERANCE CLASS (PER PES-004):	D
MATERIAL:	SEE ORIGINAL DRAWINGS
REVISION:	1 PER CDC 19-165/NMK
DRAWN:	NK
CHECKED:	SRM
DATE:	8/18/2017
DRAWING NO.:	EA1366
REV.:	1

THIS DRAWING CONTAINS MATERIAL THAT IS CONFIDENTIAL AND/OR PRIVILEGED FOR THE SOLE USE OF THE INTENDED RECIPIENT. ANY REVIEW, RELIANCE OR DISTRIBUTION BY OTHERS OR FORWARDING WITHOUT EXPRESS PERMISSION IS STRICTLY PROHIBITED.